

OSM/LUM DECISION SHEET (DSH)

Standard(s) (incl. year)	Subclause(s):	Tracking No.	Year
EN 60598-1:2015/A1:2018	0.4	DSH 0817A	2019
Category:			
LITE			
Subject:	Key words:	Developed by	Approved at
Floodlight with mounting accessories	- Floodlight - Mounting accessories - Part of installation	OSM/LUM-ETF5	2019 ETICS Plenary Meeting
Question			
<p>The figures given in Annex describe different mounting possibilities for a floodlight.</p> <ol style="list-style-type: none"> 1) Figure A: floodlight alone. 2) Figure B: floodlight with accessory wall bracket + connecting box. 3) Figure C: floodlight with accessory wall bracket + connecting box including terminal. 4) Figure D: floodlight with accessory wall bracket + connecting box including terminal and cord for internal wiring. <p>When the accessories are delivered with the luminaires, which configurations are acceptable?</p>			
Decision			
<p>Figures A - B - D – acceptable. Note for B: installation instructions are required. Figure C - not acceptable, because internal wiring is missing between the lamp compartment and the terminal block in the wall bracket.</p>			
Explanatory notes ---			

Figures

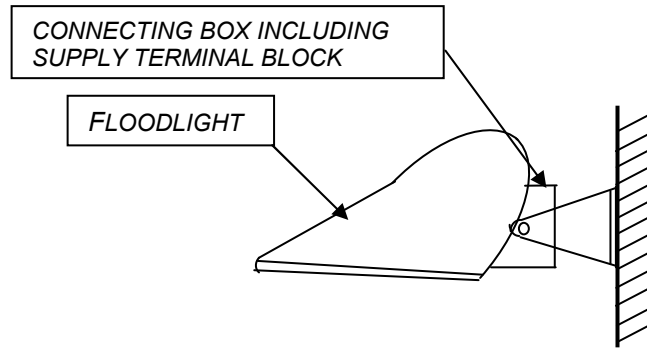


FIGURE A: Floodlight Alone.

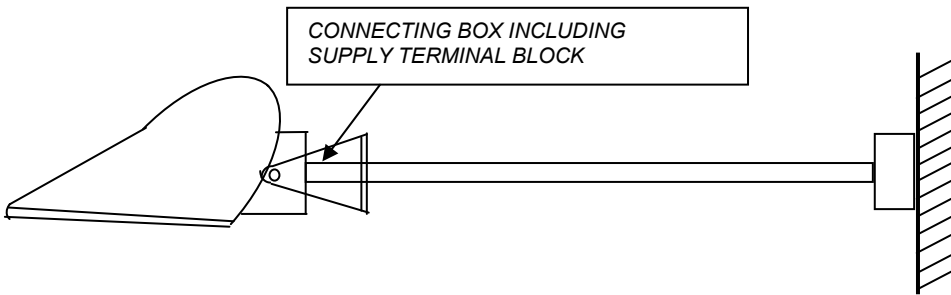


FIGURE B: Floodlight with accessory wall bracket + connecting box.

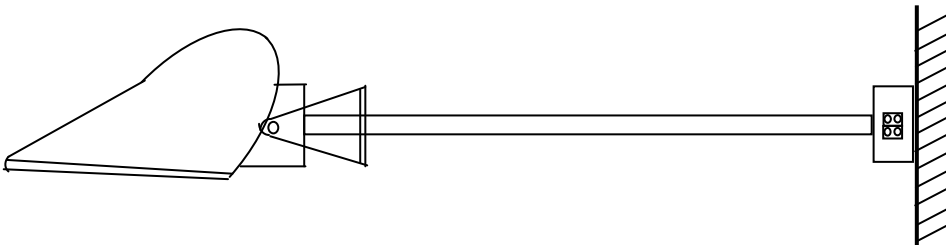


FIGURE C: Floodlight with accessory wall bracket + connecting box including terminal.

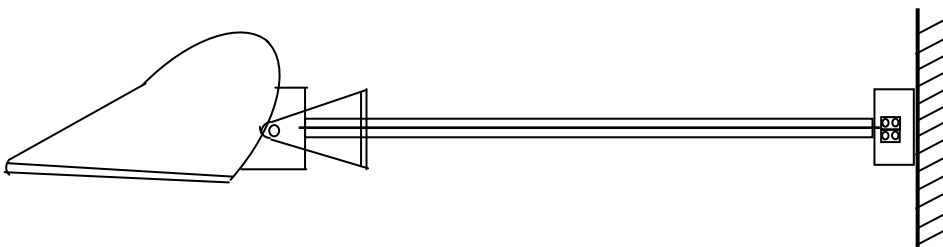


FIGURE D: Floodlight with accessory wall bracket box including terminal and cord (internal wiring) to be mounted by the user.